


	DISTANCES				
	POINTS	A	B	C	D
SEPTIC TANK	E	47.0'	41.1'		
SEPTIC TANK	F	40.8'	32.8'		
DISTRIBUTION BOX	G	49.4'	47.6'		
INSPECTION PORTS	H	36.9'	33.6'		
	I	63.4'	61.1'		
	J	70.3'	79.4'		
	K	49.0'	59.0'		
WELL	N			39.2'	40.7'

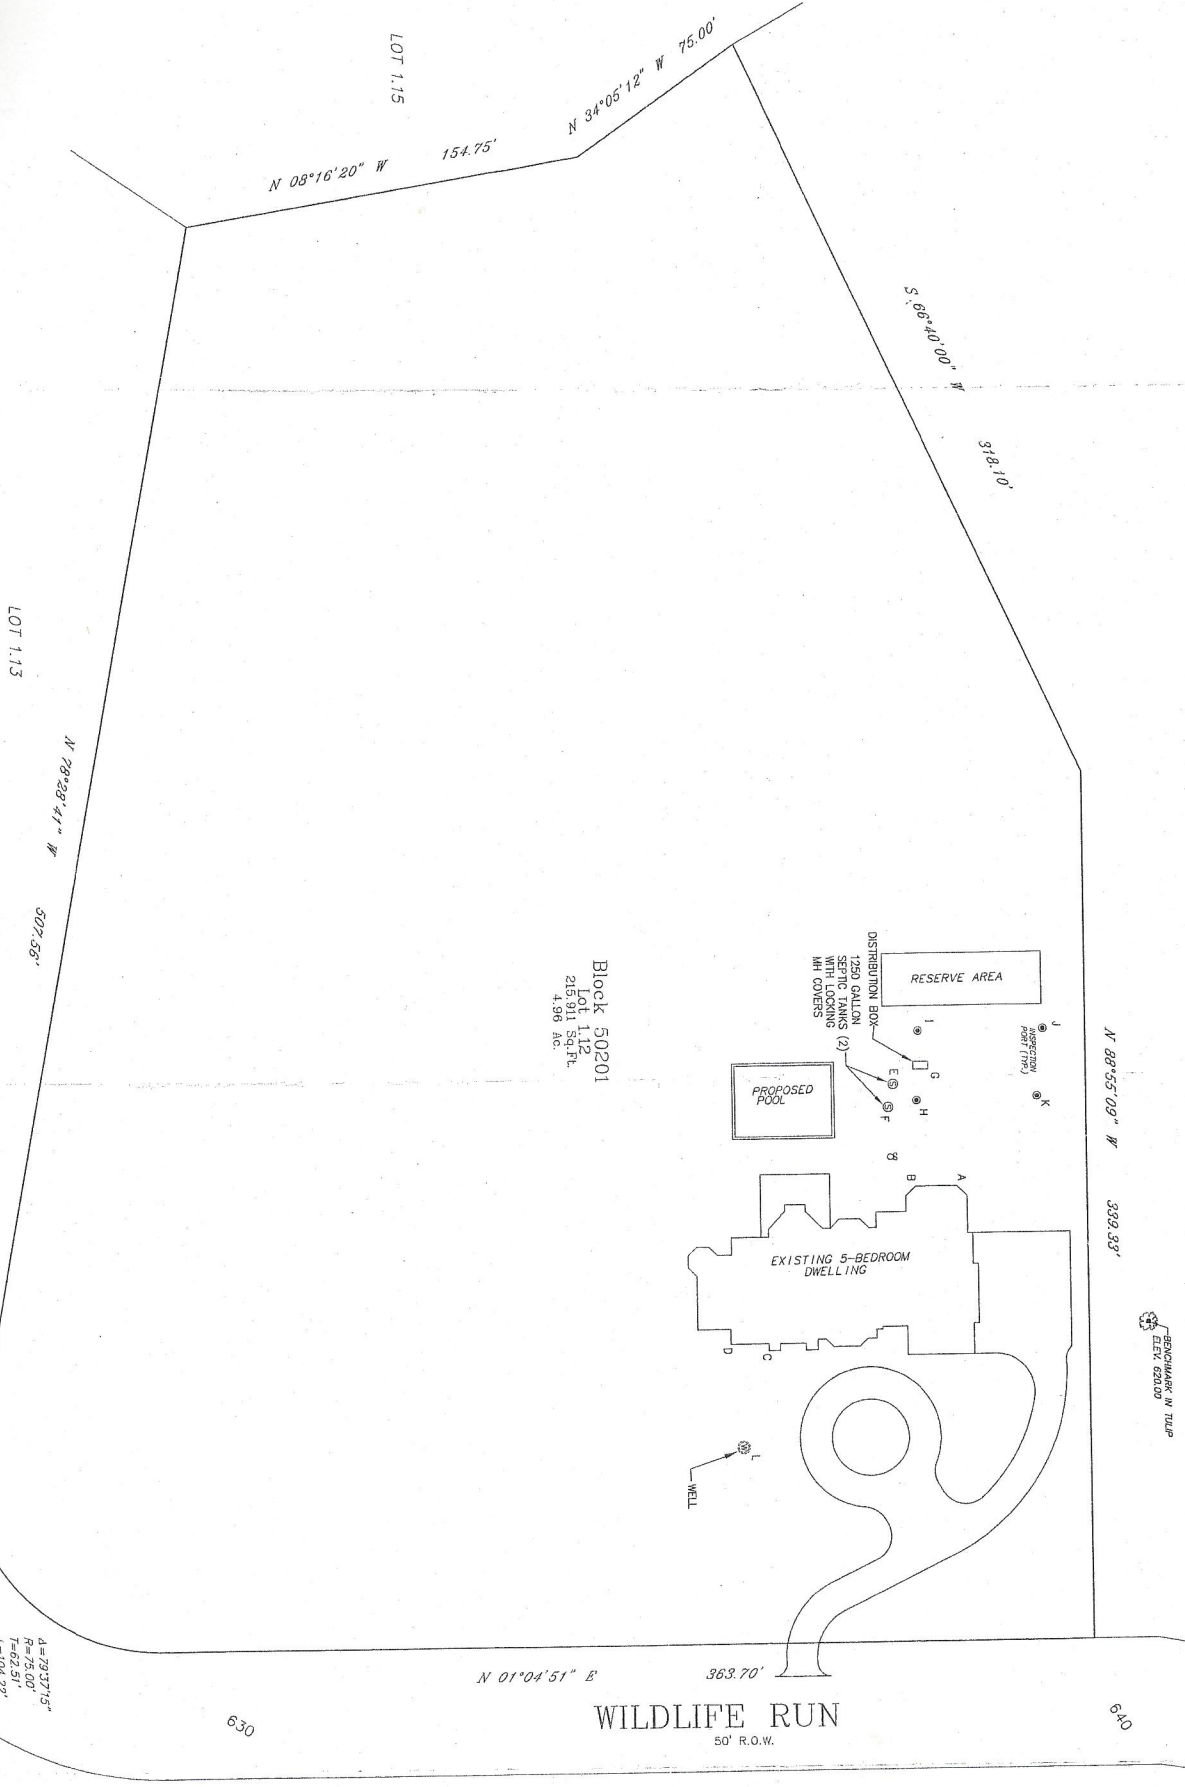

NOTE
 1. T-F
 2. T-F
 DAV

NO
 BOI
 HEI
 BY
 OF
 RE

A=79.37'±
 P=75.00'
 T=62.51'
 L=104.22'